



Test Report No.: <i>Prüfbericht - Nr.:</i>		50145579 001		Page 1 of 8 Seite 1 von 8	
Client: <i>Auftraggeber:</i>		Aldridge Traffic Systems 12-14 Leeds Street, Rhodes, NSW 2138, Australia			
Test item: <i>Gegenstand der Prüfung:</i>		17W PLED Street Light with PE cell sensor			
Identification: <i>Bezeichnung:</i>		PLED.II.14W	Serial No.: Serien-Nr.:		N/A
Receipt No.: <i>Wareneingangs-Nr.:</i>		1113010296	Date of receipt: Eingangsdatum:		2018-05-09
Condition of test item at delivery: <i>Zustand des Prüfgegenstandes bei Anlieferung:</i>		Production sample			
Testing location: <i>Prüfart:</i>		TÜV Rheinland Australia Pty. Ltd. 182 Dougharty Road, Heidelberg West, VIC 3081, Australia			
Test specification: <i>Prüfgrundlage:</i>		-			
Test Result: <i>Prüfergebnis:</i>		The item was supplied for results only with no compliance limits. Das Objekt wurde nur für Ergebnisse geliefert, ohne Konformitätsgrenzen.			
Testing Laboratory/ <i>Prüflaboratorium:</i>		TÜV Rheinland Australia Pty. Ltd. 182 Dougharty Road, Heidelberg West, VIC 3081, Australia			
Compiled by/ <i>zusammengestellt:</i>			Reviewed by/ <i>kontrolliert:</i>		
<i>16-May-2018</i>	Daniel Ngo/ Test Engineer		<i>16-May-2018</i>	Grant Li/ Reviewer	
Date <i>Datum</i>	Name/Position <i>Name/Stellung</i>	Signature <i>Unterschrift</i>	Date <i>Datum</i>	Name/Position <i>Name/Stellung</i>	Signature <i>Unterschrift</i>
Other Aspects/ <i>Sonstiges:</i>					
- Power consumption measurement at rated voltage for AEMO (Australian Energy Market Operator) at lab condition (Ambient (20±5)°C, Relative Humidity (45–75)%).					
Abkürzungen:			Abbreviations:		
P(ass) = entspricht Prüfgrundlage			P(ass) = passed		
F(ail) = entspricht nicht Prüfgrundlage			F(ail) = failed		
N/A = nicht anwendbar			N/A = not applicable		
N/T = nicht getestet			N/T = not tested		
This test report relates to the a. m. test sample. Without permission of the test center this test report is not permitted to be duplicated in extracts. This test report does not entitle to carry any safety mark on this or similar products.					
Dieser Prüfbericht bezieht sich nur auf das o.g. Prüfmuster und darf ohne Genehmigung der Prüfstelle nicht auszugsweise vervielfältigt werden. Dieser Bericht berechtigt nicht zur Verwendung eines Prüfzeichens.					

Revision 5.0

Accredited for compliance
with ISO/IEC 17025
Technical Competence




Test Report																				
<p>General remarks:</p> <ol style="list-style-type: none"> 1. This report shall not be reproduced, except in full. 2. Details in test data / test plan no. 1113010296 3. Reporting of results herein is in accordance with NATA recommendations taking into account U of M. <ol style="list-style-type: none"> (a) For minimum limits - Where measurement is on the limit or above the limit it is deemed to comply. Where measurement is below the limit it is deemed not to comply. (b) For maximum limits - Where measurement is on the limit or below the limit it is deemed to comply. Where measurement is above the limit it is deemed not to comply. 4. For reporting of results the estimated uncertainty for measurement taken into account at 95% confidence level. 5. This test report is based on assessment and tests applied to the specific test item(s) as submitted by the client. 6. TÜV Rheinland Australia disclaims any and all responsibility or obligation for any other item. 7. LCP test was conducted on 10 fittings together with PE cells per requested schemes. 																				
<p>Description of the test item:</p> <p>Test items are branded: Aldridge Traffic Systems</p> <p>Model / type number: PLED.II.14W; Rating: 230VAC, 50Hz, 0.79A, 17W, IP65, IK 06, Class I. CCT: 4200K. Lamp control gear: Mean Well; Model Number: LPF-25D-48; Input: 100-240VAC, 0.4A, 50/60Hz; Output: +48VDC, 0.53A; Rating: t_a: 50°C, t_c: 70°C, IP67, λ = 0.95, Class II. PE cell sensor: Tyco Electronics; Model/type number: 8090-VFS; Rating: 105-305VAC, 50/60Hz, 1000W.</p>																				
<p>Options/accessories/ancillary equipment:</p> <p>The equipment was tested without any optional accessory installed. Hence, this report does not cover parameters that are influenced by the installation of optional accessory that might affect safety in the meaning of this standard.</p>																				
<p>Uncertainty of equipment used:</p> <table border="1" style="width: 100%; border-collapse: collapse; margin-top: 10px;"> <thead> <tr> <th style="width: 15%;">Equipment</th> <th style="width: 15%;">Equipment No.</th> <th style="width: 20%;">Range used</th> <th style="width: 15%;">Uncertainty (%)</th> <th style="width: 35%;">Calibration Due Date</th> </tr> </thead> <tbody> <tr> <td rowspan="4" style="vertical-align: top;">Digital Power Meter Model: WT310</td> <td rowspan="4" style="vertical-align: top; text-align: center;">MEL-1464</td> <td>Voltage: 1.5V-600V</td> <td style="text-align: center;">±0.4</td> <td rowspan="4" style="vertical-align: top; text-align: center;">11-Oct-2018</td> </tr> <tr> <td>Current: 20A</td> <td style="text-align: center;">±0.5</td> </tr> <tr> <td>Power: 100W</td> <td style="text-align: center;">±0.5</td> </tr> <tr> <td>Power Factor: 0.8 - 1</td> <td style="text-align: center;">±0.8</td> </tr> </tbody> </table>					Equipment	Equipment No.	Range used	Uncertainty (%)	Calibration Due Date	Digital Power Meter Model: WT310	MEL-1464	Voltage: 1.5V-600V	±0.4	11-Oct-2018	Current: 20A	±0.5	Power: 100W	±0.5	Power Factor: 0.8 - 1	±0.8
Equipment	Equipment No.	Range used	Uncertainty (%)	Calibration Due Date																
Digital Power Meter Model: WT310	MEL-1464	Voltage: 1.5V-600V	±0.4	11-Oct-2018																
		Current: 20A	±0.5																	
		Power: 100W	±0.5																	
		Power Factor: 0.8 - 1	±0.8																	
<p>Test procedure:</p> <p>The submitted test samples (consisted of the supplied lamp and control gear combination, if applicable) for the lamp circuit power consumption measurement were placed in a draught free room and at the laboratory condition (Ambient (20±5)°C, Relative Humidity (45–75)%) for 24 hours before and during the measurement.</p> <p>The test samples were connected to the power source and supplied with voltage and frequency as listed in "TABLE: Power Measurement". The test samples were operated until the conditions of overall temperature equilibrium were established or at least 4 hours in stabilized operation with the supplied sources. Then the total power consumption measurements have been taken by power meter.</p>																				

	Test Item	Supplied Voltage (V)	Frequency (Hz)	Measured Power (W)	Measured Current (mA)	Power Factor
1	PLED.II.14W light fitting fitted with Tyco PE cell	220	50	17.62	84.77	0.945
		230	50	17.70	82.10	0.938
		240	50	17.80	79.74	0.929
2	PLED.II.14W light fitting fitted with Tyco PE cell	220	50	17.56	84.29	0.947
		230	50	17.64	81.65	0.939
		240	50	17.74	79.31	0.932
3	PLED.II.14W light fitting fitted with Tyco PE cell	220	50	17.62	84.65	0.946
		230	50	17.69	81.96	0.938
		240	50	17.77	79.61	0.930
4	PLED.II.14W light fitting fitted with Tyco PE cell	220	50	17.52	84.09	0.946
		230	50	17.59	81.43	0.939
		240	50	17.68	79.06	0.932
5	PLED.II.14W light fitting fitted with Tyco PE cell	220	50	17.46	83.73	0.948
		230	50	17.55	81.07	0.941
		240	50	17.63	78.71	0.934
6	PLED.II.14W light fitting fitted with Tyco PE cell	220	50	17.78	85.18	0.949
		230	50	17.86	82.43	0.942
		240	50	17.94	80.01	0.935
7	PLED.II.14W light fitting fitted with Tyco PE cell	220	50	17.52	84.07	0.947
		230	50	17.61	81.40	0.940
		240	50	17.70	79.12	0.932
8	PLED.II.14W light fitting fitted with Tyco PE cell	220	50	17.73	85.01	0.948
		230	50	17.78	82.24	0.941
		240	50	17.87	79.82	0.933
9	PLED.II.14W light fitting fitted with Tyco PE cell	220	50	17.47	83.81	0.948
		230	50	17.56	81.12	0.941
		240	50	17.66	78.91	0.932

10	PLED.II.14W light fitting fitted with Tyco PE cell	220	50	17.78	85.14	0.949
		230	50	17.86	82.44	0.942
		240	50	17.94	80.02	0.934

Marking

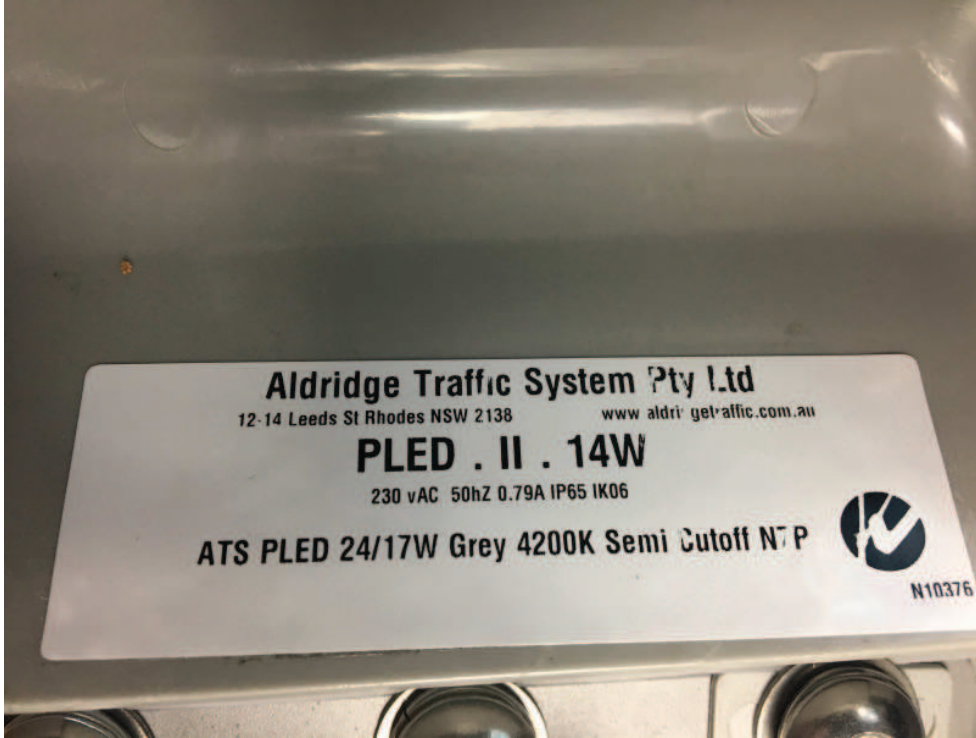

Rating Label



LED Driver Label


Photos




Front View




Back View

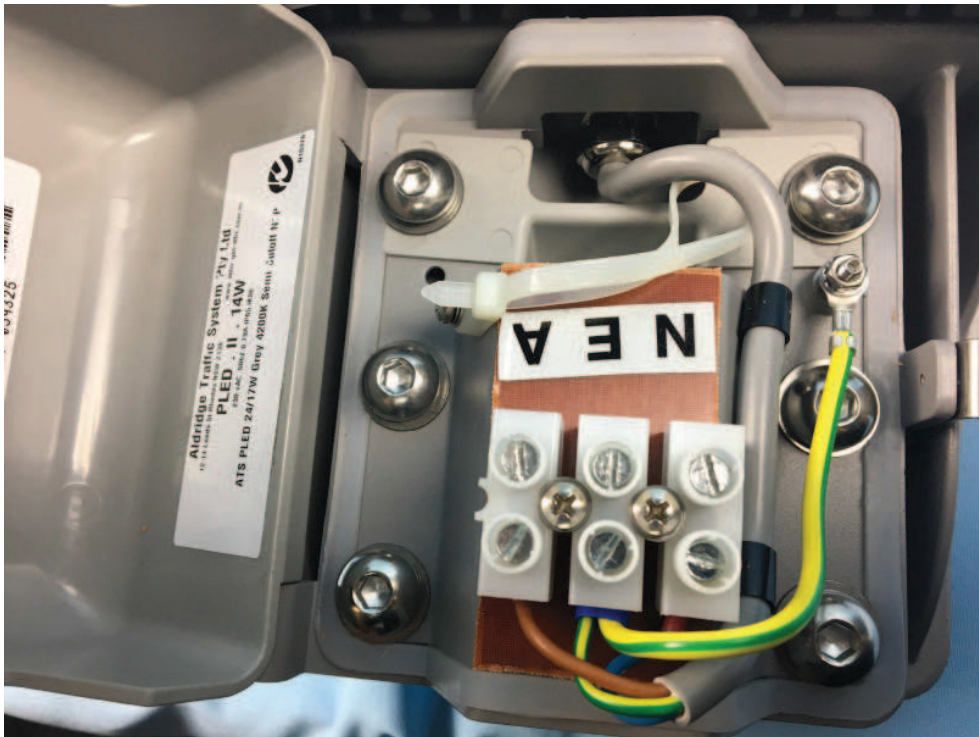


Product - Electrical connection compartment

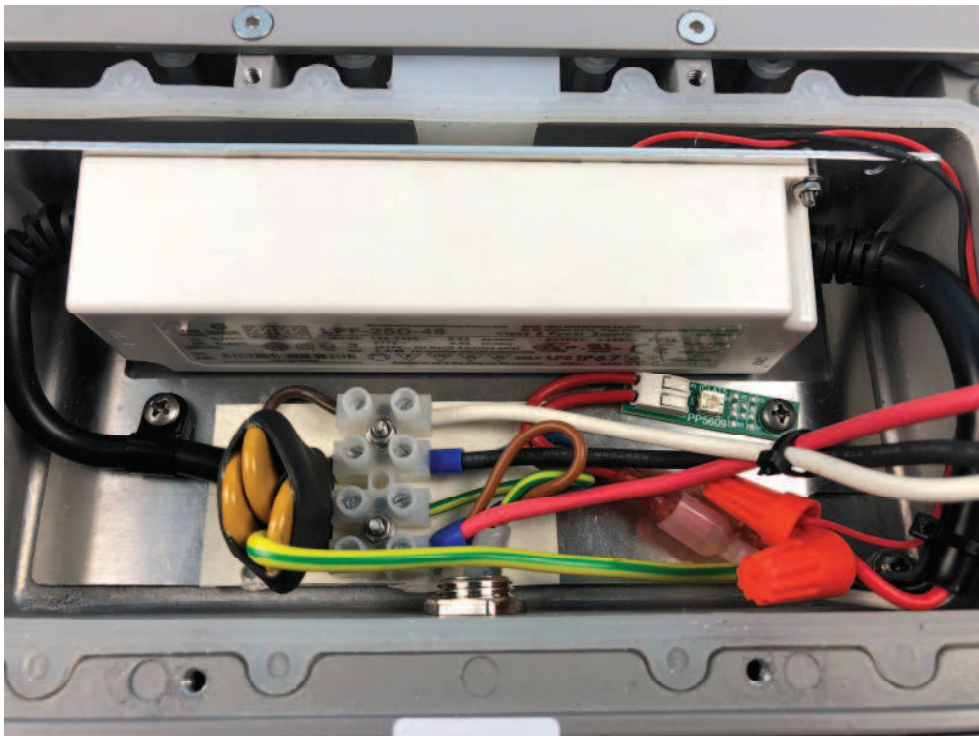

LED driver - Electrical connection compartment

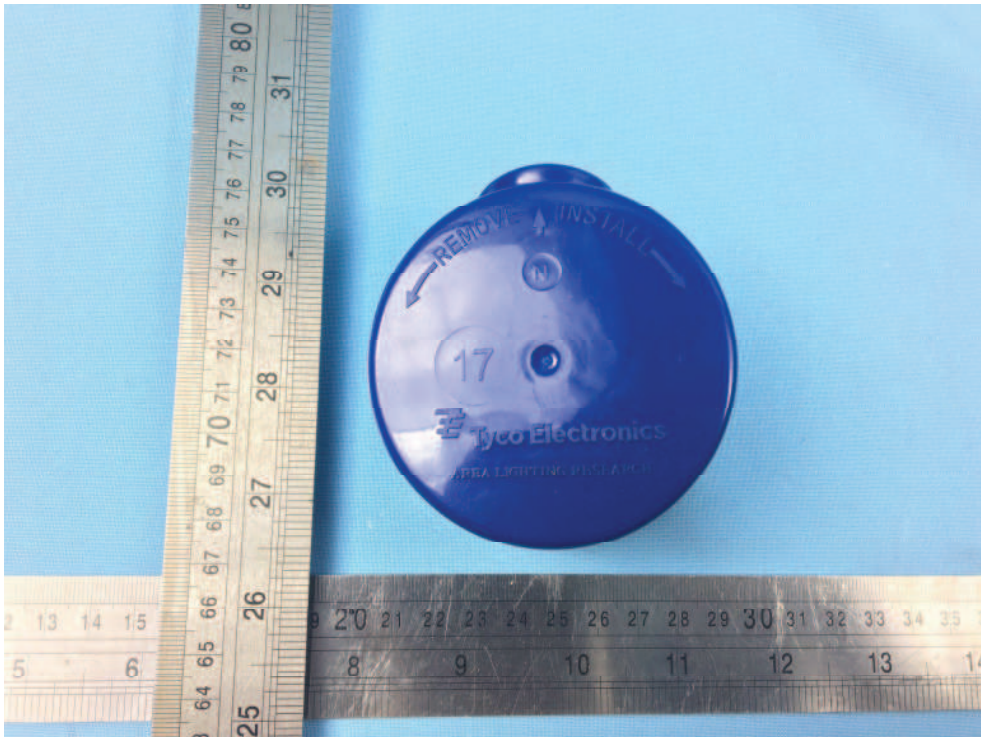

PE cell sensor - front view

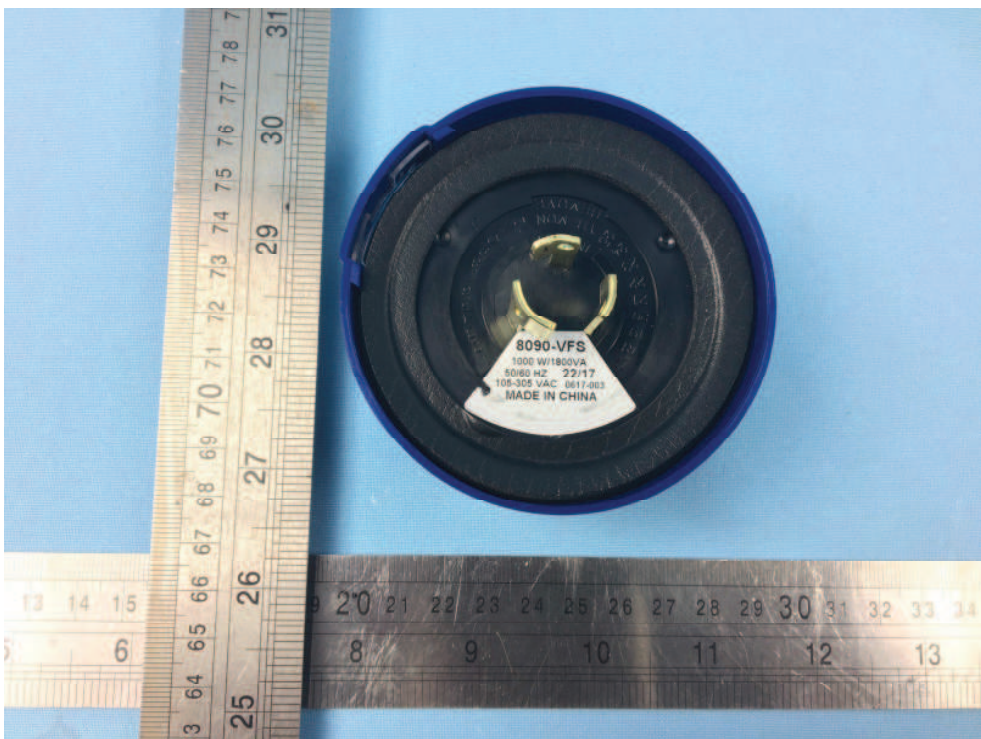

PE cell sensor – back view

End of the Test Report