


WEM Relaxed Constraints

July 2025

Q2 2025

A summary of the total number, frequency and type of Constraints that were relaxed in order to resolve infeasible dispatch solutions



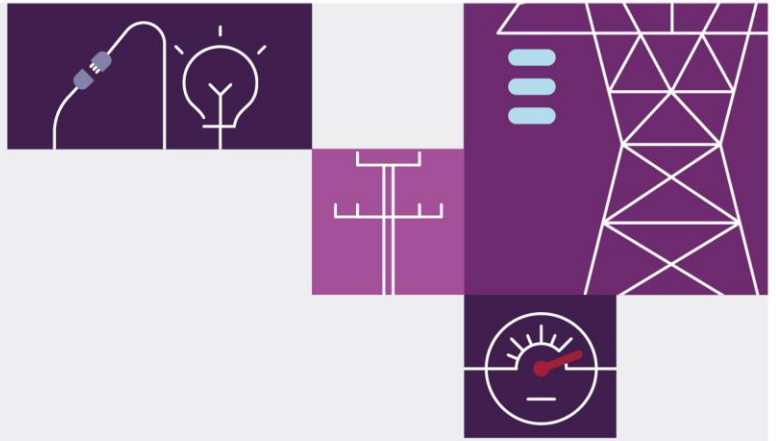

Important notice

Purpose

Under clause 7.2.7 of the ESM Rules, AEMO must as soon as practicable after the end of each quarter, publish on the WEM Website a report summarising the total number, frequency and type of Constraints that were relaxed under clause 7.2.6 during that quarter.

Disclaimer

This document or the information in it may be subsequently updated or amended. This document does not constitute legal or business advice and should not be relied on as a substitute for obtaining detailed advice about the Wholesale Electricity Rules. AEMO has made reasonable efforts to ensure the quality of the information in this document but cannot guarantee its accuracy or completeness.

Copyright

© 2025 Australian Energy Market Operator Limited. The material in this publication may be used in accordance with the [copyright permissions on AEMO's website](#).

Relaxed Constraints

1.1 Introduction

Under clause 7.2.6 of the Electricity System and Market (ESM) Rules, AEMO may “relax” Constraints used in the Central Dispatch Process in order to resolve infeasible dispatch solutions. If the WEM Dispatch Engine (WEMDE) is not able find a feasible solution, it determines which Constraints to relax¹ and by how much using the concept of Constraint Violation Penalty (CVP²), whereby the cost of relaxing a Constraint depends on its associated CVP value.

Under clause 7.2.7(b) of the ESM Rules, AEMO must as soon as practicable after the end of each quarter, publish on the WEM Website a report summarising the total number, frequency and type of Constraints that were relaxed under clause 7.2.6 during that quarter.

1.2 Summary of relaxed Constraints

Table 1 shows the breakdown of relaxed constraints by category and trading month. Note that a constraint that was relaxed in multiple intervals has been counted multiple times.

Table 1 – Breakdown of category and trading month of relaxed Constraints for Q2 of 2025

Constraint Type	Description	April	May	June	Total
Ramp Up	Formulation ³ Constraint used to limit Facility ramping. See section 2.4.13 of WEM Procedure: Dispatch Algorithm Formulation .	4261	4467	89	8817
Minimum Enablement for ESS (Essential System Services)	Formulation Constraint used to prevent a Facility being dispatch below its ESS Enablement Minimum value. See section 2.2.15 of WEM Procedure: Dispatch Algorithm Formulation .	36	22	42	100
Defined Contingency	Non-formulation constraints of type “Facility Risk” or “Network Risk” used to calculate the Largest Credible Supply Contingency. See section 2.4.8 of WEM Procedure: Dispatch Algorithm Formulation .	0	0	0	0
Network Constraint	Non-formulation constraints of type “Network”. These Constraint Equations correspond to a Network Limit. See ESM Rule 7.2.4(e).	146	21	34	201
Other	Non-formulation constraints of type “Other”. These Constraint Equations are used to meet Power System Security and Power System Reliability requirements, that do not form part of the above categories. See ESM Rule 7.2.4(f).	8	1	0	9
Total		4451	4511	165	9127

¹ In the context of the WEM Dispatch Engine, relaxed Constraints are also called violating Constraints.

² For more information about Constraint Violation Penalties see [WEM Procedure: Dispatch Algorithm Formulation](#)

³ Formulation constraints are included in the formulation of the Dispatch Algorithm (see [WEM Procedure: WEM Dispatch Algorithm Formulation](#)) and hence do not form part of the Constraints Library.



Table 2 contains a summary of the number of Primary Dispatch Intervals in which Constraints were relaxed.

Table 2 – Amount of Primary Dispatch Intervals with various numbers of relaxed Constraints for Q2 of 2025

N	0	1	2	3	4	5	6	7	8	9	10	>10
Number of Primary Dispatch Intervals with N relaxed Constraints	18,276	6733	1133	53	8	0	1	0	4	0	0	0
Percentage of Dispatch Intervals with N relaxed Constraints	70%*	26%	4.3%	<1%	<1%	0%	<1%	0%	<1%	0%	0%	0%

*The majority (70%) of intervals had no relaxed Constraints (N = 0) meaning that the Dispatch Algorithm found a feasible solution without violating any Constraints.