



TransGrid

Summary: Maintaining compliance with performance standards applicable to Wagga 330 kV substation secondary systems

RIT-T Project Assessment Conclusions Report

Region: Southern

Date of issue: 4 May 2020

Disclaimer

This suite of documents comprises TransGrid's application of the Regulatory Investment Test for Transmission (RIT-T) which has been prepared and made available solely for information purposes. It is made available on the understanding that TransGrid and/or its employees, agents and consultants are not engaged in rendering professional advice. Nothing in these documents is a recommendation in respect of any possible investment.

The information in these documents reflect the forecasts, proposals and opinions adopted by TransGrid at the time of publication, other than where otherwise specifically stated. Those forecasts, proposals and opinions may change at any time without warning. Anyone considering information provided in these documents, at any date, should independently seek the latest forecasts, proposals and opinions.

These documents include information obtained from the Australian Energy Market Operator (AEMO) and other sources. That information has been adopted in good faith, without further enquiry or verification. The information in these documents should be read in the context of the Electricity Statement of Opportunities, the National Transmission Network Development Plan published by AEMO and other relevant regulatory consultation documents. It does not purport to contain all of the information that AEMO, a prospective investor, Registered Participant or potential participant in the National Electricity Market (NEM), or any other person may require for making decisions. In preparing these documents it is not possible, nor is it intended, for TransGrid to have regard to the investment objectives, financial situation and particular needs of each person or organisation which reads or uses this document. In all cases, anyone proposing to rely on or use the information in this document should:

1. Independently verify and check the currency, accuracy, completeness, reliability and suitability of that information
2. Independently verify and check the currency, accuracy, completeness, reliability and suitability of reports relied on by TransGrid in preparing this document
3. Obtain independent and specific advice from appropriate experts or other sources.

Accordingly, TransGrid makes no representations or warranty as to the currency, accuracy, reliability, completeness or suitability for particular purposes of the information in this suite of documents.

Persons reading or utilising this suite of RIT-T related documents acknowledge and accept that TransGrid and/or its employees, agents and consultants have no liability for any direct, indirect, special, incidental or consequential damage (including liability to any person by reason of negligence or negligent misstatement) for any damage resulting from, arising out of or in connection with, reliance upon statements, opinions, information or matter (expressed or implied) arising out of, contained in or derived from, or for any omissions from the information in this document, except insofar as liability under any New South Wales and Commonwealth statute cannot be excluded.

Privacy notice

TransGrid is bound by the *Privacy Act 1988 (Cth)*. In making submissions in response to this consultation process, TransGrid will collect and hold your personal information such as your name, email address, employer and phone number for the purpose of receiving and following up on your submissions.

Under the National Electricity Law, there are circumstances where TransGrid may be compelled to provide information to the Australian Energy Regulator (AER). TransGrid will advise you should this occur.

TransGrid's Privacy Policy sets out the approach to managing your personal information. In particular, it explains how you may seek to access or correct the personal information held about you, how to make a complaint about a breach of our obligations under the Privacy Act, and how TransGrid will deal with complaints. You can access the Privacy Policy here (<https://www.transgrid.com.au/Pages/Privacy.aspx>).

Summary

TransGrid is applying the Regulatory Investment Test for Transmission (RIT-T) to options for maintaining reliable secondary systems at Wagga 330 kV substation. Publication of this Project Assessment Conclusions Report (PACR) represents the final step in the RIT-T process.

Located in the Riverina region of southern NSW, Wagga 330 kV substation forms part of the wider South Western NSW network which supports renewable energy zone development. It will continue to play a central role in supporting the flow of energy to the Far West region of NSW.¹

TransGrid has identified the secondary systems at Wagga 330 kV substation have reached a condition that reflects the end of serviceable life. As it is superseded by new technology at the manufacturer level and the existing technology becomes obsolete, spare parts become scarce and the ability of any primary asset connected to the substation to reliably operate will be at risk.

Identified need: meet the service level required under the National Electricity Rules for protection schemes

Secondary systems are used to control, monitor, protect and secure communication to facilitate safe and reliable network operation.² They are necessary to operate the transmission network and prevent damage to primary assets when adverse events occur.

Provision of redundant protection schemes to ensure the transmission system is adequately protected is a Network Performance Requirement under Schedule 5.1 of the National Electricity Rules (NER), therefore the condition issues affecting the secondary systems at Wagga 330 kV substation must be addressed.

The Network Performance Requirements, set out in Schedule 5.1 of the NER, place an obligation on Transmission Network Service Providers (TNSPs) to provide redundant protection schemes to ensure the transmission system is adequately protected. Schedule 5.1.9(c) of the NER requires a TNSP to provide sufficient primary and back-up protection systems, including any communications facilities and breaker fail protection systems, to ensure that a fault of any type anywhere on its transmission system is automatically disconnected.

Additionally, TNSPs are required to disconnect the unprotected primary systems where secondary systems fault lasts for more than eight hours (for planned maintenance) or 24 hours (for unplanned outages). TNSPs must also ensure that all protection systems for lines at a voltage above 66 kV are well-maintained so as to be available at all times other than for short periods of less than eight hours for maintenance of the protection systems.³ In the event of an unplanned outage, AEMO's Power System Security Guidelines require that the primary network assets must be taken out of service within 24 hours.⁴

Furthermore, as per clause 4.11.1 of the NER, remote monitoring and control systems are required to be maintained in accordance with the standards and protocols determined and advised by AEMO.

¹ There is over 5GW of potential wind and solar generation connections in South Western NSW and the Barrier Ranges. TransGrid. "Transmission Annual Planning Report 2019." Sydney: TransGrid, 2019. 45. Accessed 18 November, 2019. <https://www.transgrid.com.au/what-we-do/BusinessPlanning/transmission-annual-planning/Documents/2019%20Transmission%20Annual%20Planning%20Report.pdf>

² As per Schedule 5.1 of the NER.

³ As per S5.1.2.1(d) of the NER.

⁴ Australian Energy Market Operator. "Power System Security Guidelines, 23 April 2019." Melbourne: Australian Energy Market Operator, 2019. Accessed 15 May 2019. https://www.aemo.com.au/-/media/Files/Electricity/NEM/Security_and_Reliability/Power_System_Ops/Procedures/SO_OP_3715---Power-System-Security-Guidelines.pdf

A failure of the secondary systems will involve replacement of the failed component or taking the affected primary assets, such as lines and transformers, out of service.

Though replacement of failed secondary systems component is a possible interim measure, the approach is not sustainable as the stock of spare components will deplete due to the technology no longer being manufactured or supported. Once all spares are used, replacement will cease to be a viable option to meet performance standards stipulated in clause 4.6.1 of the NER.

If the failure to provide functional secondary systems due to technology obsolescence is not addressed by a technically and commercially feasible credible option in sufficient time (by 2022/23), the likelihood of not recovering from secondary systems faults and not maintaining compliance with NER performance requirements will increase.

The proposed investment will enable TransGrid to continue to meet the standards for secondary systems availability set out in the NER, and to avoid the impacts of taking primary assets out of service. Consequently, it is considered a reliability corrective action under the RIT-T.

A reliability corrective action differs from a 'market benefits'-driven RIT-T in that the preferred option is permitted to have negative net economic benefits on account of it being required to meet an externally imposed obligation on the network business.

No submissions received in response to Project Specification Consultation Report

TransGrid published a Project Specification Consultation Report (PSCR) on 13 June 2019 and invited written submissions on the material presented within the document. No submissions were received in response to the PSCR.

No material developments since publication of the PSCR

No additional credible options were identified during the consultation period following publication of the PSCR.

The following changes have occurred since the PSCR which have not made an impact on the preferred option:

- > updated the discount rates used
- > inflation escalation update
- > removed unserved energy from the NPV analysis.

Option 1 remains the preferred option at this stage of the RIT-T process.

Complete in-situ replacement of protection and control systems remains the most prudent and economically efficient option to meet regulatory obligations

In the PSCR TransGrid put forward for consideration four technically and commercially feasible options:

- > **Option 1** – complete in-situ replacement of all secondary systems assets at Wagga 330 kV substation;
- > **Option 2** – strategic asset replacement involving individual replacement of identified assets up to 2023;
- > **Option 3** – a complete upgrade and renewal of secondary systems at Wagga 330 kV substation by using modular secondary system buildings (SSB) and installing new cable throughout; and
- > **Option 4** – a complete replacement of the secondary systems at Wagga 330kV substation with new IEC61850-based secondary systems technology.

Option 1 remains the most prudent and economically efficient option to address the identified need. Implementation of Option 1 will enable TransGrid to continue meeting its regulatory obligations set out in

clauses 4.11.1, 4.6.1(b),⁵ and Schedule 5.1 of the NER. Consequently, it will ensure the performance standards applicable to Wagga 330 kV substation secondary systems are met and is therefore the preferred option for this RIT-T.

The options are summarised in the table below.

TransGrid expects coronavirus (COVID-19) to impact its suppliers and disrupt their supply chains. TransGrid has preliminary advice that this is already occurring, although at this time the extent of the current or future impact is unknown. Consequently, some of the costs associated with the works outlined in this document may be affected.

All costs presented in this PACR are in 2019/20 dollars.

Table 1 Options considered

Option	Description	Capital costs (\$m 2019/20)	Operating costs ⁶ (\$ per year)	Remarks
Option 1	Complete in-situ replacement of protection and control systems	8.6 (+/- 25%)	~6,000	Preferred option, would maintain regulatory obligations and provide highest net economic benefits
Option 2	Strategic asset replacement	4.8 (+/- 25%) by 2022/23 and 0.4 (+/- 25%) by 2026/27	~6,000	Would maintain regulatory obligations but provide less benefits
Option 3	Secondary Systems Buildings replacement (SSB)	19.6 (+/- 25%)	~6,000	
Option 4	IEC-61850 ⁷ replacement	15.3 (+/- 25%)	~11,000	

Non-network options are not able to assist in this RIT-T

In the PSCR, TransGrid noted that non-network options are not considered to be commercially and technically feasible to assist with meeting the identified need for this RIT-T. This is because non-network options will not

⁵ As per clause 4.6.1(b) of the NER, AEMO must ensure that there are processes in place, which will allow the determination of fault levels for normal operation of the power system and in anticipation of all credible contingency events and protected events that AEMO considers may affect the configuration of the power system, so that AEMO can identify any busbar which could potentially be exposed to a fault level which exceeds the fault current ratings of the circuit breakers associated with that busbar.

⁶ Including corrective maintenance.

⁷ International Electrotechnical Commission (IEC), "IEC 61850 standard for Power Utility Automation," accessed 14 March, 2019. <http://www.iec.ch/smartgrid/standards/>

enable TransGrid to continue meeting its NER obligation to provide redundant secondary systems and ensure that the transmission system is adequately protected.

Conclusion: complete in-situ replacement of the protection and control systems at Wagga 330 kV substation is optimal

The optimal commercially and technically feasible option presented in the PSCR – Option 1 (complete in-situ replacement of protection and control systems) – remains the preferred option to meet the identified need. Option 1 can be implemented in sufficient time to meet the identified need by 2022/23, and is therefore the preferred option presented in this PACR.

Moving forward with this option is the most prudent and economically efficient solution to enable TransGrid to continue meeting its regulatory obligations set out in clauses 4.11.1, 4.6.1(b),⁸ and Schedule 5.1 of the NER. Consequently, it will ensure the performance standards applicable to Wagga 330 kV substation secondary systems are met.

Option 1 involves replacement of all secondary systems assets at Wagga 330 kV substation. This option will modernise the automation philosophy to current design standards and practices. This option also includes replacement of Direct Current (DC) supplies to account for an increase in secondary systems power requirements and remediation of the 415V Alternating Current (AC) distribution in the building and the switchyard.

The estimated capital cost of this option is approximately \$8.6 million. Routine and operating maintenance costs are approximately \$6,000 per year.

The works will be undertaken between 2019/20 and 2021/22. Planning and procurement (including completion of the RIT-T) will occur between 2018/19 and 2019/20, while the procurement and delivery of the identified assets is planned to occur prior 2020/21 and all works will be completed by 2021/22.

Necessary outages of relevant assets in service will be planned appropriately in order to complete the works with minimal impact on the network.

The analysis undertaken and the identification of Option 1 as the preferred option satisfies the RIT-T.

⁸ As per clause 4.6.1(b) of the NER, AEMO must ensure that there are processes in place, which will allow the determination of fault levels for normal operation of the power system and in anticipation of all credible contingency events and protected events that AEMO considers may affect the configuration of the power system, so that AEMO can identify any busbar which could potentially be exposed to a fault level which exceeds the fault current ratings of the circuit breakers associated with that busbar.


Next steps

This PACR represents the third step in a formal Regulatory Investment Test for Transmission (RIT-T) process undertaken by TransGrid. It follows a Project Specification Consultation Report (PSCR) released in June 2019. The second step, production of a Project Assessment Draft Report (PADR), was not required as the investment in relation to the preferred option is exempt from this part of the RIT-T process under NER clause 5.16.4(z1). Production of a PADR is not required⁹ due to:

- > the estimated capital cost of the proposed preferred option being less than \$43 million;
- > the PSCR states:
 - proposed preferred option (including reasons for the proposed preferred option)
 - RIT-T is exempt from producing a PADR
 - the proposed preferred option and any other credible option will not have material market benefits¹⁰ except for voluntary load curtailment and involuntary load shedding
- > RIT-T proponent considers that there were no PSCR submissions identifying additional credible options that could deliver a material market benefit; and
- > PACR must address any issues raised in relation to the proposed preferred option during the PSCR consultation.

As noted in the PSCR, the investments are intended to continue meeting Rules obligations and will not have material market benefit, therefore TransGrid is exempt from producing a PADR for this RIT-T.

Figure 1 This PACR is the third stage of the RIT-T process¹¹

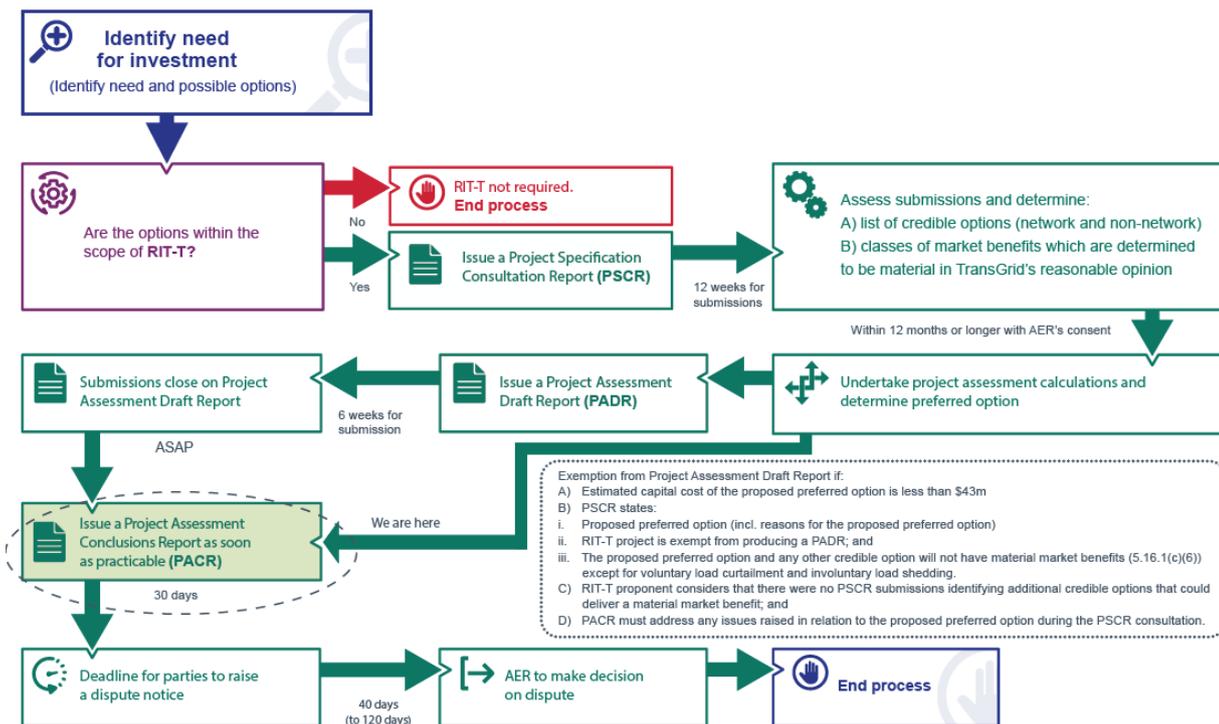

⁹ In accordance with NER clause 5.16.4(z1)(4), the exemption from producing a PADR will no longer apply if TransGrid considers that an additional credible option that could deliver a material market benefit is identified during the consultation period. No additional credible options were identified.

¹⁰ As per clause 5.16.1(c)(6)

¹¹ Australian Energy Market Commission. "Replacement expenditure planning arrangements, Rule determination". Sydney: AEMC, 18 July 2017.65. Accessed 19 November 2019. <https://www.aemc.gov.au/sites/default/files/content/89fbf559-2275-4672-b6ef-c2574eb7ce05/Final-rule-determination.pdf>

Parties wishing to raise a dispute notice with the AER may do so prior to 2 June 2020 (30 days after publication of this PACR). Any dispute notices raised during this period will be addressed by the AER within 40 to 120 days, after which the formal RIT-T process will conclude.

Further details on the RIT-T can be obtained from TransGrid's Regulation team via RIT-TConsultations@transgrid.com.au. In the subject field, please reference 'Wagga 330 kV Secondary Systems PACR'.

To read the full Project Assessment Conclusions Report visit the [Regulatory Investments Test page](#) on TransGrid's website.