

# **Summary: Managing risk on Lines 21, 22, 959 & 92Z (conductor condition)**

RIT-T Project Specification Consultation Report

Issue date: 14 February 2024



## Disclaimer

---

This suite of documents comprises Transgrid's application of the Regulatory Investment Test for Transmission (RIT-T) which has been prepared and made available solely for information purposes. It is made available on the understanding that Transgrid and/or its employees, agents and consultants are not engaged in rendering professional advice. Nothing in these documents is a recommendation in respect of any possible investment.

The information in these documents reflect the forecasts, proposals and opinions adopted by Transgrid at the time of publication, other than where otherwise specifically stated. Those forecasts, proposals and opinions may change at any time without warning. Anyone considering information provided in these documents, at any date, should independently seek the latest forecasts, proposals and opinions.

These documents include information obtained from the Australian Energy Market Operator (AEMO) and other sources. That information has been adopted in good faith without further enquiry or verification. The information in these documents should be read in the context of the Electricity Statement of Opportunities, the Integrated System Plan published by AEMO and other relevant regulatory consultation documents. It does not purport to contain all of the information that AEMO, a prospective investor, Registered Participant or potential participant in the National Electricity Market (NEM), or any other person may require for making decisions. In preparing these documents it is not possible, nor is it intended, for Transgrid to have regard to the investment objectives, financial situation and particular needs of each person or organisation which reads or uses this document. In all cases, anyone proposing to rely on or use the information in this document should:

1. Independently verify and check the currency, accuracy, completeness, reliability and suitability of that information
2. Independently verify and check the currency, accuracy, completeness, reliability and suitability of reports relied on by Transgrid in preparing these documents
3. Obtain independent and specific advice from appropriate experts or other sources.

Accordingly, Transgrid makes no representations or warranty as to the currency, accuracy, reliability, completeness or suitability for particular purposes of the information in this suite of documents.

Persons reading or utilising this suite of RIT-T-related documents acknowledge and accept that Transgrid and/or its employees, agents and consultants have no liability for any direct, indirect, special, incidental or consequential damage (including liability to any person by reason of negligence or negligent misstatement) for any damage resulting from, arising out of or in connection with, reliance upon statements, opinions, information or matter (expressed or implied) arising out of, contained in or derived from, or for any omissions from the information in this document, except insofar as liability under any New South Wales and Commonwealth statute cannot be excluded.

## Privacy notice

Transgrid is bound by the *Privacy Act 1988 (Cth)*. In making submissions in response to this consultation process, Transgrid will collect and hold your personal information such as your name, email address, employer and phone number for the purpose of receiving and following up on your submissions.

Under the National Electricity Law, there are circumstances where Transgrid may be compelled to provide information to the Australian Energy Regulator (AER). Transgrid will advise you should this occur.

Transgrid's Privacy Policy sets out the approach to managing your personal information. In particular, it explains how you may seek to access or correct the personal information held about you, how to make a complaint about a breach of our obligations under the Privacy Act, and how Transgrid will deal with complaints. You can access the Privacy Policy here (<https://www.transgrid.com.au/Pages/Privacy.aspx>).

## Summary

---

We are applying the Regulatory Investment Test for Transmission (RIT-T) to options for remediating deteriorating conductor condition on four transmission lines in the Transgrid overhead transmission network (Line 21, Line 22, Line 959 and Line 92Z). Publication of this Project Specification Consultation Report (PSCR) represents the first step in the RIT-T process.

Transgrid's overhead transmission network contains sections where the condition of conductors is deteriorating such that they have reached, or are close to reaching, end of life. The deteriorated condition of conductors can be caused by a variety of mechanisms such as:

- annealing due to bushfire exposure;
- corrosion initiated by bushfire exposure; and
- corrosion at mid-span joint locations.

We have undertaken analysis of conductor condition and deterioration mechanisms across its network, which identified approximately 1,100 km circuit length of conductors that have condition issues that require attention.

We have also undertaken analysis of bushfire impact history and mid-span joint locations, mapped against corrosion zones, and identified the locations that were likely exposed to the degradation mechanisms described above. Various inspections<sup>1</sup> have identified visual indicators of degradation such as broken strands, bulging, visible white product, discolouration, out of lay strands and discolouration.

### Identified need: managing risks on Line 21, Line 22, Line 959 and Line 92Z

If action is not taken, the conductor deterioration is expected to expose us and our customers to increasing level of risks going forward, as the likelihood of failure increases. There are safety and bushfire risks under the 'do nothing' base case, as well as higher expected costs associated with reactive maintenance that may be required under emergency conditions ('financial risk'). The proposed investment will enable us to manage safety, bushfire and financial risks on the selected lines.

Options considered under this RIT-T have been assessed relative to a base case. Under the base case, no proactive capital investment is made and the condition of the lines will continue to deteriorate.

Further condition deterioration of the affected conductors would mean an increase in safety and bushfire risks as the likelihood of failure increases. If left untreated, conductor deterioration could result in incidents such as conductor drop. Such incidents could have considerable safety consequences for nearby residents and members of the public, as well as our field crew who may be working on or near the assets. These incidents also pose environmental risks through potential bushfires.

We manage and mitigate safety and environmental risk to ensure they are below risk tolerance levels or 'As Low As Reasonably Practicable' ('ALARP'), in accordance with our obligations under the *New South Wales Electricity Supply (Safety and Network Management) Regulation 2014* and our Electricity Network Safety Management System (ENSMS).<sup>2</sup>

---

<sup>1</sup> Inspections include Smart Aerial Image Processing (SAIP), and ground and aerial based inspections.

<sup>2</sup> Our ENSMS follows the International Organization for Standardization's ISO31000 risk management framework which requires following a hierarchy of hazard mitigation approach.

The proposed investment will enable us to continue to manage and operate this part of the network to a safety and risk mitigation level of ALARP, consistent with our obligations. Consequently, we consider it to be a reliability corrective action under the RIT-T. A reliability corrective action differs from a ‘market benefits’-driven RIT-T in that the preferred option is permitted to have negative net economic benefits on account of it being required to meet an externally imposed obligation on the network business.

### One credible option has been considered

We consider that there is only one feasible option from a technical, commercial, and project delivery perspective that can be implemented in sufficient time to meet the identified need.

Option 1 involves a targeted replacement of existing conductors along Lines 21, 22, 959 and 92Z, which have been identified as priority lines based on expected NPV per kilometre and outage constraints. The cumulative length of all segments contained within this option is 51 km. The remediation includes replacement of all conductor compression fittings, suspension clamps/Armour Grip Suspension Units (AGSU), jumper connections, spacers and vibration dampers on relevant sections of lines.

The estimated capital cost of Option 1 is approximately \$36.6 million. Table E-1 sets out the build period, year of commissioning, and cost of conductor replacement for each line under Option 1.

Table E-1: Build period, commissioning, and cost of each line under Option 1

Line	Build period	Commissioning	Capital expenditure
Line 21	2024/25 to 2025/26	2025/26	7.7
Line 22	2024/25 to 2026/27	2026/27	9.3
Line 959	2025/26 to 2026/27	2027/28	8.2
Line 92Z	2025/26 to 2026/27	2027/28	11.4
<b>Total</b>			<b>36.6</b>

Although the timeline for replacement varies for each line, the overall project is expected to commence in 2024/25 and conclude by 2027/28.

Option 1 will not affect annual routine operating costs since it does not affect the frequency of inspections.

### There is no expectation of needing to uprate the lines at this point in time

The proposed replacement works under Option 1 is focused on condition-based, like-for-like replacement. We do not expect the conductors included in this RIT-T need to be uprated at this point in time as we do not expect the line loadings to exceed their existing line ratings in the near future.

Lines 21 and 22, along with Lines 25, 26, 5A1 and 5A2, are the main transmission lines connecting generation in the Hunter and Central Coast regions to Sydney. The 500 kV lines (Line 5A1 and 5A2) will continue to take the majority of the flow from the Central Coast to Sydney. The line utilisation data in our 2023 Transmission Annual Planning Report shows Line 21 (330 kV) has a maximum utilisation rate of 34% and Line 22 (330 kV) has a maximum utilisation rate of 88% under credible contingency. Lines 959 and 92Z (both 132 kV lines) are in parallel with Line 27 and 28 (both 330 kV lines) between Sydney North and

Sydney East. Lines 959 and 92Z have a maximum utilisation rate of 42% and 22% under credible contingency, respectively.<sup>3</sup>

Specifically, we consider that uprating would cost significantly more than Option 1 and not add a commensurate increase in estimated market benefit. Uprating is therefore not considered commercially feasible at this point in time.

### Non-network options are not expected to be able to assist with this RIT-T

We do not consider non-network options to be commercially and technically feasible to assist with meeting the identified need for this RIT-T, as non-network options will not mitigate the safety, environmental and financial risks posed as a result of asset deterioration.

### The option has been assessed against three reasonable scenarios

The credible option has been assessed under three scenarios as part of this PSCR assessment, which differ in terms of the key drivers of the estimated net market benefits (ie, the estimated risk costs avoided).

Given that wholesale market benefits are not relevant for this RIT-T, the three scenarios assume the expected most likely scenario for the 2024 ISP (ie, the ‘Step Change’ scenario). The scenarios differ by the assumed level of risk costs. Risk cost assumptions do not form part of AEMO’s ISP assumptions and have been based on Transgrid’s analysis.

Table E-2: Summary of scenarios

Variable / Scenario	Central	Low risk cost scenario	High risk cost scenario
Scenario weighting	1/3	1/3	1/3
Discount rate	7.0%	7.0%	7.0%
Network capital costs	Base estimate	Base estimate	Base estimate
Operating and maintenance costs	Base estimate	Base estimate	Base estimate
Safety, environmental, and financial risk benefit	Base estimate	Base estimate – 25%	Base estimate +25%


We have weighted the three scenarios equally given there is nothing to suggest an alternate weighting would be more appropriate.

### Option 1 delivers significant net benefits

The costs under Option 1 are found to be significantly outweighed by the expected benefit of avoiding the risks in each scenario investigated. On a weighted basis, Option 1 is found to deliver net economic benefits of \$329.5 million in present value terms.

<sup>3</sup> Transgrid, *Transmission Annual Planning Report 2023*, p.155

Figure E-1: Net economic benefits of Option 1 (\$m, PV)

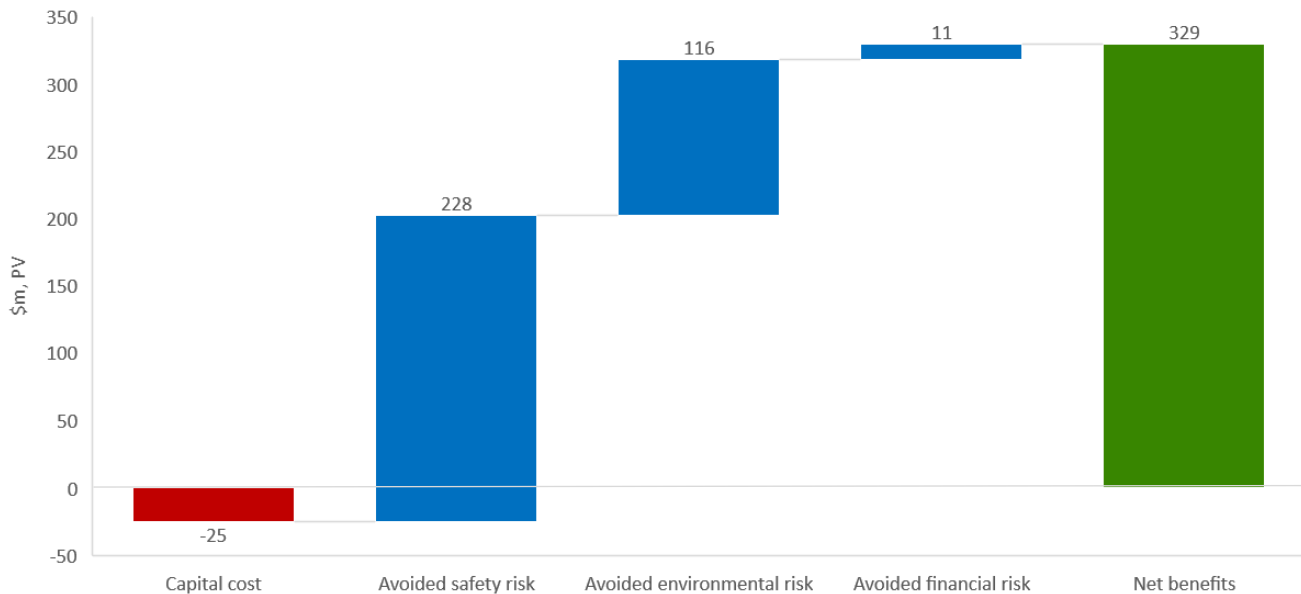

### Draft conclusion

This PSCR has found that Option 1 is the preferred option at this draft stage of the RIT-T. Option 1 involves the replacement of approximately 51 kilometres of conductors on Lines 21, 22, 959 and 92Z. Moving forward with this option is the most prudent and economically efficient solution to manage and mitigate safety and bushfire risk to ALARP. Consequently, it will ensure our obligations under the *New South Wales Electricity Supply (Safety and Network Management) Regulation 2014* and our ENSMS are met.

The estimated capital expenditure associated with the option is \$36.6 million (in 2023/24 dollars) and the works are estimated to take place between 2024/25 and 2029/30.

### Exemption from preparing a PADR

NER clause 5.16.4(z1) provides for a TNSP to be exempt from producing a PADR for a particular RIT-T application, in the following circumstances:

- if the estimated capital cost of the preferred option is less than \$46 million;
- if the TNSP identifies in its PSCR its proposed preferred option, together with its reasons for the preferred option and notes that the proposed investment has the benefit of the clause 5.16.4(z1) exemption; and
- if the TNSP considers that the proposed preferred option and any other credible options in respect of the identified need will not have a material market benefit for the classes of market benefit specified in clause 5.16.1(c)(4), with the exception of market benefits arising from changes in voluntary and involuntary load shedding.

We consider that the investment in relation to Option 1 and the analysis presented in this PSCR meets these criteria and therefore that we are exempt from producing a PADR under NER clause 5.16.4(z1).

In accordance with NER clause 5.16.4(z1)(4), the exemption from producing a PADR will no longer apply if we consider that an additional credible option that could deliver a material market benefit is identified during the consultation period.

Accordingly, if we consider that any such additional credible options are identified, we will produce a PADR which includes an NPV assessment of the net market benefit of each additional credible option.

Should we consider that no additional credible options were identified during the consultation period that could have material market benefits, we intend to produce a PACR that addresses all submissions received, including any issues in relation to the proposed preferred option raised during the consultation period, and presents our conclusion on the preferred option for this RIT-T.

## Submissions and next steps

We welcome written submissions on materials contained in this PSCR. Submissions are due on 14 May 2024.

Submissions should be emailed to our Regulation team via [regulatory.consultation@transgrid.com.au](mailto:regulatory.consultation@transgrid.com.au).<sup>4</sup> In the subject field, please reference 'Conductor condition on Lines 21, 22, 959 and 92Z PSCR'.

At the conclusion of the consultation process, all submissions received will be published on our website. If you do not wish for your submission to be made public, please clearly specify this at the time of lodgement.

Subject to additional credible options being identified, we anticipate publication of a PACR in June 2024.

---

<sup>4</sup> We are bound by the *Privacy Act 1988 (Cth)*. In making submissions in response to this consultation process, we will collect and hold your personal information such as your name, email address, employer and phone number for the purpose of receiving and following up on your submissions. If you do not wish for your submission to be made public, please clearly specify this at the time of lodgement. See Privacy Notice within the Disclaimer for more details.